



Assessment of the Nitoproof 910 - Waterproofing Membrane to AS 3740 for testing to AS/NZS 4858:2004 wet area membranes

Report number SW8638-01 [This is a private relabel report from CSIRO test report SW8501-01]
CSIRO job number SW8638

Date of issue 27 February 2026

Client

Parchem Construction Supplies Pty Ltd
1956 Dandenong Rd,
Clayton
VIC 3168
Australia

TERM OF VALIDITY

This CSIRO Wet Area Membranes 1st revalidation report will retain validity to 20/12/2026.
Revalidation/reassessment is required to extend conformity beyond this date.

Commercial-in-confidence

Use of Reports – Testing

This report is subject to binding obligations under which it was prepared. In particular, the Report must not be used:

- As a means of endorsement; or,
- In a company prospectus or notification to a Stock Exchange document for capital raising, without the prior written consent of CSIRO.

The Report may be published verbatim and in full, provided that a statement is included on the publication that it is a copy of the Report issued by CSIRO.

Excerpts of the Report may not be published.

Use of Reports – Consultancy

This report is subject to binding obligations under which it was prepared. In particular, the Report may only be used for the following purposes:

- The information in the Report may be used by the party that commissioned the Report for its internal business operations (but not licensing to third parties);
- The report may be copied for distribution within the organisation that commissioned the Report;
- Copies of the Report (or extracts of the Report) may be distributed to contractors and agents of the organisation that commissioned the Report who have a need for the Report for its internal business operations. Any extracts of the Report distributed for this purpose must clearly note that the extract is part of a larger Report held by the organisation that commissioned the Report and which has been prepared by CSIRO.

The name, trademark or logo of the CSIRO must not be used without the prior written consent of CSIRO.

The Report must not be used as a means of endorsement without the prior written consent of CSIRO.

Copyright and disclaimer

©2026 CSIRO To the extent permitted by law, all rights are reserved and no part of this publication covered by copyright may be reproduced or copied in any form or by any means except with the written permission of CSIRO.

Important disclaimer

CSIRO advises that the information contained in this publication comprises observations based on test results. The reader is advised and needs to be aware that such information may be incomplete or unable to be used in any specific situation. No reliance or actions must therefore be made on that information without seeking prior expert professional, scientific and technical advice. To the extent permitted by law, CSIRO (including its employees and consultants) excludes all liability to any person for any consequences, including but not limited to all losses, damages, costs, expenses, and any other compensation, arising directly or indirectly from using this publication (in part or in whole) and any information or material contained in it.

Limitation

The results reported herein relate only to the item(s) tested.

Contents

| | |
|-----------------------------------------------------------------------------------|----|
| <i>Contents</i> | 3 |
| <i>Tables</i> | 4 |
| 1 Summary..... | 5 |
| Test Standard: | 5 |
| Test results:..... | 5 |
| 2 Introduction..... | 7 |
| 3 Test specimen description..... | 8 |
| 4 Test Methodology..... | 8 |
| 4.1 <i>ASTM E96/E96M – 16 Water Vapour Transmission of materials</i> | 8 |
| 4.2 <i>AS 3558.1-1999 Determination of water absorption characteristics</i> | 9 |
| 4.3 <i>AS/NZS 4858-2004 Appendix B Resistance to cyclic movement</i> | 9 |
| 4.4 <i>AS/NZS 4858-2004 Appendix A Durability of membrane</i> | 9 |
| 5 Results | 10 |
| 5.1 <i>ATSM E96/E96M - 16 Water Vapour Transmission of materials</i> | 10 |
| 5.2 <i>AS 3558.1-1999 Determination of water absorption characteristics</i> | 11 |
| 5.3 <i>AS/NZS 4858-2004 Appendix B Resistance to cyclic movement</i> | 12 |
| 5.4 <i>AS/NZS 4858-2004 Appendix A Durability of membrane</i> | 13 |
| 6 Comments | 15 |

Figure 1 Top face of Nitoproof 910 – Waterproofing Membrane..... 8

Figure 2 Underside of Nitoproof 910 – Waterproofing Membrane..... 8

Figure 3 Test apparatus and weighing of Nitoproof 910 - Waterproofing Membrane..... 11

Figure 4 Images of test sample performing durability load / elongation test 14

Tables

Table 1 Summary of test requirements and test specimen results for AS/NZS 4858:2004..... 5

Table 2 Details of submitted test specimen..... 7

Table 3 Details of the schedule for testing of the submitted specimen 7

Table 4 Water Vapour Transmission test results 10

Table 5 Water absorption tests results 11

Table 6 Test sample holding during cyclic movement and test results..... 12

Table 7 Durability test results..... 13

1 Summary

Test Standard: Testing was conducted on a waterproofing membrane used for internal wall and floor tiled areas, to assess its performance for: water vapour transmission; water absorption; acceptance of cycle movement; and durability. The waterproofing properties required by AS 3740 were tested in accordance with the Australian Standard AS/NZS 4858-2004.

All methods were carried out according to Table A1 durability of membranes against the performance criteria of Table 8.1.

Test results: The waterproofing membrane presented for testing complied with the performance criteria set in AS/NZS 4858-2004 'Wet area membranes', confirmed against AS 3740. The following table shows the Nitoproof 910 - Waterproofing Membrane performance as assessed from testing.

Table 1 Summary of test requirements and test specimen results for AS/NZS 4858:2004

| TEST | METHOD | REQUIREMENTS | RESULT | STATUS |
|-------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------|----------|
| (a) Moisture Transmission Rate | ASTM E 96 Desiccant method for Determining Water Vapour Transmission (WVT) | Water Vapour transmission shall be $<8 \text{ g} / \text{m}^3 / 24\text{hrs}$. If $> 8 \text{ g} / \text{m}^3 / 24\text{hrs}$, additional testing will be required to establish suitability for use over particleboard. | WVT 7.79 $\text{g}/\text{m}^2/24\text{hrs}$ Permeance 64.17 $\text{ng}/\text{Pa}\cdot\text{s}\cdot\text{m}^2$ | Complied |
| (b) Water Absorption | AS 3558.1 Average percentage increase in mass | Maximum record result of percentage mass $w_m\% = (w_m^2 - w_m^1) / w_m^1 \times 100$. | Max. mass 1.88 % | Complied |
| (c) Acceptance of movement | AS/NZS 4858 Appendix B for assessment of cyclic movement of membrane | Pass or fail criteria by observing any cracking, rupture holing or extending through the thickness for more than 1 mm in from the edge of the specimen. | Class III | Complied |
| (d) Durability 1. Control 2. Water immersion 3. Bleach immersion 4. Detergent immersion 5. Heat ageing at 50°C | AS/NZS 4858 & Appendix A for assessment of membranes durability | Pass or fail criteria; compared to control samples, elongation at break shall be not less than 50 % for the bond breakers given in Table 6.1. | Class III | Complied |

SUMMARY OF RESULTS

AS/NZS 4858:2004 Wet Area Membranes

Appendix A: Assessment of Durability of waterproof membranes

| Test Report No. | 8319.1 | SW8501-01 | |
|-------------------------|--------|-----------|------------------|
| Year of test | 2020 | 2023 | |
| Control | 328% | 332% | Class III |
| Water Immersion@56 days | 349% | | PASS |
| Bleach Immersion | 355% | | PASS |
| Detergent Immersion | 362% | | PASS |
| Heat Ageing @ 50 °C | 368% | | PASS |

Parchem Construction Supplies Pty Ltd, test sample, the Nitoproof 910 - Waterproofing Membrane achieves the performance requirements of AS/NZS 4858: 2004 Durability of Membranes for Class III membrane installation.

Appendix B: Assessment of resistance of waterproofing membranes to cyclic movement

Pass or fail criteria by observing any cracking, rupture holing or extending through the thickness for more than 1 mm in from the edge of the specimen.

Result: No fatigue cracking exhibited. PASS

ASTM E96: Water Vapour Transmission of Materials

Result: 7.79 g/m²/24h PASS

AS 3558.1 Methods of testing plastics & composite materials sanitary plumbing fixtures:

Method 1: Determination of water absorption characteristics

| | | | |
|---------|----------|-------|---------------|
| Result: | Sample 1 | 1.36% | |
| | Sample 2 | 1.47% | |
| | Sample 3 | 1.88% | Maximum 1.60% |

Appendix C: Suitability of waterproofing membranes when used over particle board.

Not required.

Note: The above is only a summary of the overall results and must be read in conjunction with the relevant sections of this report.

2 Introduction

CSIRO Services was engaged by Parchem Construction Supplies Pty Ltd to assess a waterproofing membrane for compliance against AS 3740-2010 'Waterproofing of domestic wet areas', Section 2, Clause 2.4.1 (d) 'Membranes meeting the requirements of AS/NZS 4858', determined by testing to AS/NZS 4858:2004, 'Wet area membranes' (this Standard sets out the methods for establishing the physical properties for wet area membranes). The details for this assessment are listed in Table 2 below.

Table 2 Details of submitted test specimen.

| | |
|-----------------------------|----------------------------------------|
| CSIRO Agreement No.: | SW8638 |
| TEST SPONSOR: | Parchem Construction Supplies Pty Ltd |
| PRODUCT DESCRIPTION: | Nitoproof 910 - Waterproofing Membrane |

Note: CSIRO accepts no responsibility for the selection of specimens. The results in this report apply to the specimens tested and may not be applicable to other specimens of the same product.

This report details the performance, testing conditions and outcomes of the specimen assessed for wet area membranes. Table 3 details the sponsor's specified schedule of tests for the product.

Table 3 Details of the schedule for testing of the submitted specimen.

| | |
|-----------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| CSIRO Agreement No.: | SW8638 |
| TEST SCHEDULE: | <p>AS/NZS 4858:2004 wet area membranes, Clause 8 Table 8.1:</p> <ul style="list-style-type: none"> a) Moisture vapour transmission rate - ASTM Designation E96/E96M – 16, 'Standard Test Methods for Water Vapour Transmission'; b) Water absorption AS 3558.1-1999 'Method of testing plastics and composite materials sanitary plumbing fixtures, Method 1 Determination of water absorption'; c) Acceptance of cyclic movement; Appendix B 'Assessment of resistance of waterproofing membranes to cyclic movement'; and, d) Durability - Appendix A 'Assessment of durability of waterproofing membranes: <ul style="list-style-type: none"> Table A1 (a) Controls Table A1 (b) Water immersion Table A1 (c) Bleach immersion Table A1 (d).Detergent immersion Table A1 (e) Heat aging 50°C |

3 Test specimen description

The Nitoproof 910 - Waterproofing Membrane supplied by Parchem Construction Supplies Pty Ltd is a one-component moisture curing membrane and has a polyurethane base. The nominal size of the membrane was 200 mm wide, 430 mm length and 1.2 mm thick.

For 1st revalidation, The nominal size of the membrane 300 X 150 X ~1.00 mm, 3 sheets.

The supplied specimen for assessment is shown below in Figures 1 and 2.

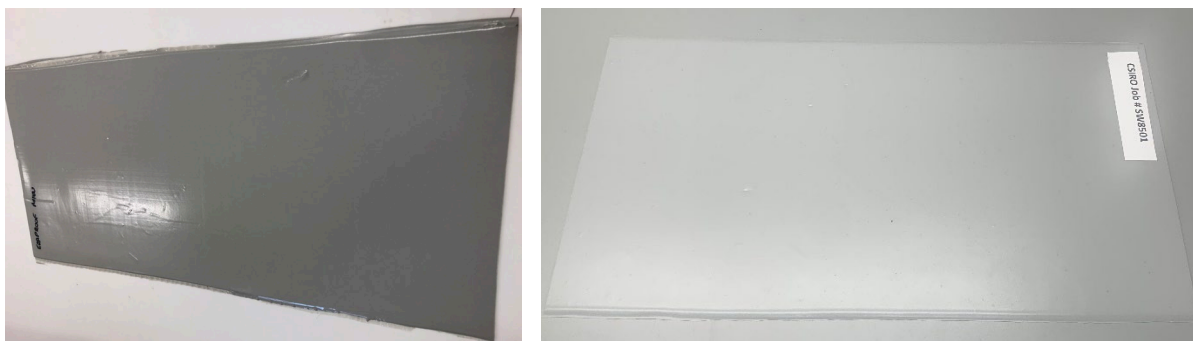


Figure 1 Top face of Nitoproof 910 – Waterproofing Membrane

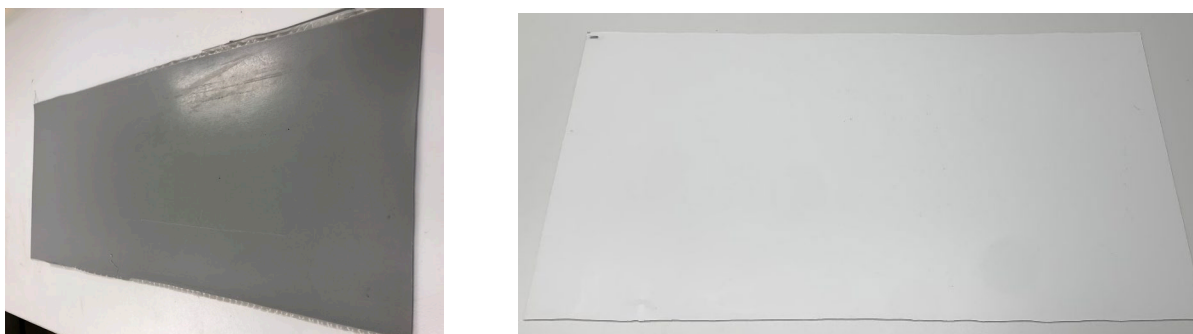


Figure 2 Underside of Nitoproof 910 – Waterproofing Membrane

4 Test Methodology

4.1 ASTM E96/E96M – 16 Water Vapour Transmission of materials

This Standard outlines the method for determining water vapour transmission (WVT) through the membrane using the desiccant and dummy sample method.

Four test samples were prepared by mechanical sealed using two neoprenes and a Teflon gasket placed onto the open side of the test cups. The test cups contain dried desiccant with the trafficable side facing up were placed in a climate-controlled environment with periodic weighing so that the rate of water vapour movement through the membrane to the desiccant can be determined.

The exposed area (test dish face) for each of the cups was 0.002827 m². The test cups (all except the dummy sample, no desiccant) had a 6 mm gap between the desiccant and the underside of the membrane.

All test assemblies were kept in a Steridium environmental where chamber temperature humidity is maintained at a temperature of 23 ±2°C and 50 ±5% relative humidity, for the 37 days duration.

Measurements taken each afternoon (excluding weekends) over this period to determine the weight change and permeance of the membrane.

4.2 AS 3558.1-1999 Determination of water absorption characteristics

This Standard outlines the method for determining the percentage of mass change of the membrane measured after a period of immersion in water, followed by a period of being oven dried.

Three circular test samples of 80 mm diameter (5027 mm²) were cut from Nitoproof 910 - Waterproofing Membrane, before been placed in an oven set at 50 ±5°C for a duration of 24 ±0.5 hrs conditioning. Samples were removed from oven (cooled) then weighed and recorded (m¹) before insertion in a test jig. The test jig was used to expose the trafficable surface face of the samples to water to a depth of 50 mm above the surface for a duration of 24 ±0.25 hrs. After the completion of this exposure period the samples were wiped dry and then weighed and recorded (m²) again, determining the percentage increase in weight measured.

4.3 AS/NZS 4858-2004 Appendix B Resistance to cyclic movement

This Standard outlines the method for determining resistance of membrane to cyclic movement set at 4mm extension.

A rectangular test sample of 65 mm x 25 mm x 1.22 mm was cut from the Nitoproof 910 - Waterproofing Membrane, then held in the test grips (70(w) x 45(l) x 20(t) mm), exposing a 25 x 2 mm central portion of the sample.

An Applied Test Systems Series 904 Vertical Sealant Tester was used for testing. The vertical sealant testing machine used software for cyclic movement control. The vertical testing machine was set to elongate the clamped test sample for the cycling is 4mm extension. Once the test piece reached full extension, it then returned to its original position, which completed one cycle of movement. The elongation and return was then repeated to complete a 50 cycle movement test, each cycle conducted over a nominal 2 hour period.

The test sample was inspected for signs of breakage or cracks and measured for any necking. A reduction in width of more than 1 mm inwards from the edge of the test sample constitutes a failure.

4.4 AS/NZS 4858-2004 Appendix A Durability of membrane

This Standard outlines the method for determining resistance of the membrane's durability after conditioning in various solutions over set periods, then assessed against an unconditioned material.

Testing of the Nitoproof 910 - Waterproofing Membrane was in accordance with Appendix A Durability of membranes. As specified in A3 the membrane test samples were prepared in accordance with AS 1145.3-2001, Type 5, dumb-bell samples 6mm width with a 25mm gauge length. Test samples were exposed and conditioned to those requirements specified in Table A1 of AS/NZS 4858:2004.

In accordance with A2 Testing, a universal testing machine, fitted with a calibrated 5kN load cell, was used to record the elongation at break and tensile strength. The elongation at break of the immersed test samples were compared to the control test samples.

5 Results

5.1 ATSM E96/E96M - 16 Water Vapour Transmission of materials.

The periodic measurements of the membrane test samples were recorded as shown in Table 4, below.

Date of test: 29 July 2020 – 4 September 2020

Table 4 Water Vapour Transmission test results

| Product | Samples | Weight change | Water Vapour Transmission | Permeance |
|----------------------------------------|-----------|------------------------|-----------------------------------|----------------------------------------|
| | | G/t = g / s | (G/t)/A = g / m ² 24hr | WVT/(S9R1-R2) = ng/Pa.s.m ² |
| Nitoproof 910 - Waterproofing Membrane | 8319.1/53 | 2.3 x 10 ⁻⁷ | 7.07 | 58.29 |
| | 8319.1/54 | 2.6 x 10 ⁻⁷ | 7.88 | 64.91 |
| | 8319.1/55 | 2.8 x 10 ⁻⁷ | 8.41 | 69.32 |
| | Average | 2.5 x 10 ⁻⁷ | 7.79 | 64.17 |

The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1, specifies a water vapour transmission rate of less than 8 g/m² 24 hr, or 0.33 g/m² hr.

5.2 AS 3558.1-1999 Determination of water absorption characteristics

The measured dimensions of the test samples placed in the test rig stand are shown in Table 4, below.

Date of test: 02nd July 2020

Table 5 Water absorption tests results

| Product | Thickness Average | Samples | Sample weight after conditioning | Sample weight after exposure | Water absorption percentage |
|----------------------------------------|-------------------|-----------|----------------------------------|------------------------------|-----------------------------------------------------------------|
| | mm | | m ¹ = grams | m ² = grams | M % = (m ² - m ¹) / m ¹ x 100 |
| Nitoproof 910 - Waterproofing Membrane | 1.23 | 8319.1/49 | 7.9586 | 8.0670 | 1.36 % |
| | 1.18 | 8319.1/50 | 7.7282 | 7.8415 | 1.47 % |
| | 1.19 | 8319.1/51 | 7.6455 | 7.7889 | 1.88 % |
| | | | | | Average = 1.60 % |

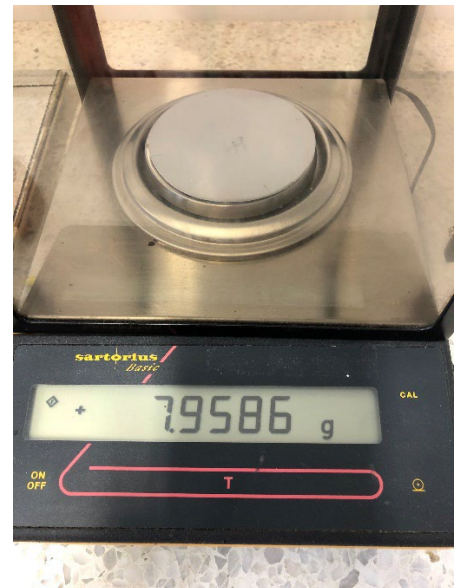


Figure 3 Test apparatus and weighing of Nitoproof 910 - Waterproofing Membrane


The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1 (b), does not specify a limit. The maximum water absorption measured on the waterproofing membrane samples was 1.88%.

5.3 AS/NZS 4858-2004 Appendix B Resistance to cyclic movement

The test result for cyclic movement of the waterproofing membrane test sample is shown in Table 6 below. The test sample completed 50 cycles for the nominal 2-hour period.

Date of test: 19 March 2020 – 23 March 2020

Table 6 Test sample holding during cyclic movement and test results.

| | | |
|--------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------|--|
| Specimen: | Nitoproof 910 – Waterproofing Membrane | |
| Test sample and elongation at break: | Test sample 65 (l) mm x 25 (w) mm x 1.22 (t) mm section; Maximum extension movement used for the cycling is 4 mm extension – Class III. | |
| Clamped test sample of cyclic test: |  | |
| Observation and measurement: | <p><u>Observations:</u> At test completion the specimen showed no signs of rupture, holing or cracking.</p> | |

The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1 (c) and section B4, pass or fail criteria by observing any rupture, holing the specimen or extending through the thickness for more than 1 mm in from the edge of the specimen.

5.4 AS/NZS 4858-2004 Appendix A Durability of membrane

The tensile strength and elongation at break were recorded for the control and immersed test samples. Criteria for pass or failure of the immersed test samples were then compared to the control samples. AS/NZS 4858:2004 Table 6.1 joint movement bond breaker was also referenced in Table 7, below.

Date of test: 01 April 2020, 03 April 2020, 24 April 2020, 25 May 2020, and 25 June 2020,

Date of test: for 1st revalidation report SW8501-01 : 15 December 2023.

Table 7 Durability test results

| Nitoproof 910 - Waterproofing Membrane | | | Tensile Strength and Elongation | | |
|---------------------------------------------------------------|--------------------|----------------|---------------------------------|-----------------------------------|---------------|
| Control samples 1 st revalidation 15/12/2023 | Break Force (N) | Thickness (mm) | Tensile strength (F/A) (MPa) | Elongation at break (mm) & (%) | Passed/Failed |
| SW8501-01/01 | 49.18 | 0.96 | 8.54 | 85.86 & 343 | - |
| SW8501-01 /02 | 43.58 | 0.94 | 7.73 | 77.59 & 310 | - |
| SW8501-01 /03 | 46.34 | 0.93 | 8.30 | 83.62 & 334 | - |
| SW8501-01/04 | 47.31 | 0.91 | 8.66 | 84.46 & 338 | - |
| SW8501-01 /05 | 43.43 | 0.92 | 7.87 | 83.02 & 332 | - |
| Average | 45.97 | 0.93 | 8.22 | 82.91 & 332 | - |
| Control samples | Break Force (N) | Thickness (mm) | Tensile strength (F/A) (MPa) | Elongation at break (mm) & (%) | Passed/Failed |
| 8319.1/01 | 50.90 | 1.26 | 6.73 | 83.19 & 333 | - |
| 8319.1/02 | 52.45 | 1.25 | 6.99 | 85.83 & 343 | - |
| 8319.1/03 | 52.63 | 1.22 | 7.19 | 86.20 & 345 | - |
| 8319.1/04 | 47.94 | 1.27 | 6.29 | 77.25 & 309 | - |
| 8319.1/05 | 47.53 | 1.25 | 6.34 | 77.68 & 311 | - |
| Average | 50.29 | 1.25 | 6.71 | 82.03 & 328 | - |
| Water Immersion | Average (N) | | Average (MPa) | Average (mm) & (%) | - |
| 7-day period | 54.20 | 1.26 | 7.14 | 83.61 & 334 | Passed* |
| 28-day period | 53.98 | 1.18 | 7.62 | 92.10 & 368 | Passed* |
| 56-day period | 54.90 | 1.19 | 7.69 | 87.20 & 349 | Passed* |
| Bleach Immersion | Average (N) | | Average (MPa) | Average (mm) & (%) | - |
| 7-day period | 60.58 | 1.29 | 7.85 | 91.83 & 367 | Passed* |
| 28-day period | 47.22 | 1.20 | 6.56 | 91.49 & 366 | Passed* |
| 56-day period | 43.89 | 1.26 | 5.81 | 88.82 & 355 | Passed* |
| Detergent Immersion | Average (N) | | Average (MPa) | Average (mm) & (%) | - |
| 7-day period | 51.11 | 1.17 | 7.28 | 90.80 & 363 | Passed* |
| 28-day period | 46.52 | 1.20 | 6.45 | 93.17 & 373 | Passed* |

Testing to AS/NZS 4858:2004 Wet area membranes.

| | | | | | |
|-------------------------------------------------------------------|-------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------|--------------------|---------|
| 56-day period | 50.63 | 1.25 | 6.75 | 90.45 & 362 | Passed* |
| Heat Ageing @ 50°C | Average (N) | | Average (MPa) | Average (mm) & (%) | - |
| 7-day period | 59.37 | 1.16 | 8.53 | 91.97 & 368 | Passed* |
| Table A1: Pass / Fail and Criteria compared with control samples. | | *Passed – Elongation at break was above the 25% limit; and all immersed samples were above the 50% criteria for elongation at break Control samples. Class III of Table 6.1. | | | |

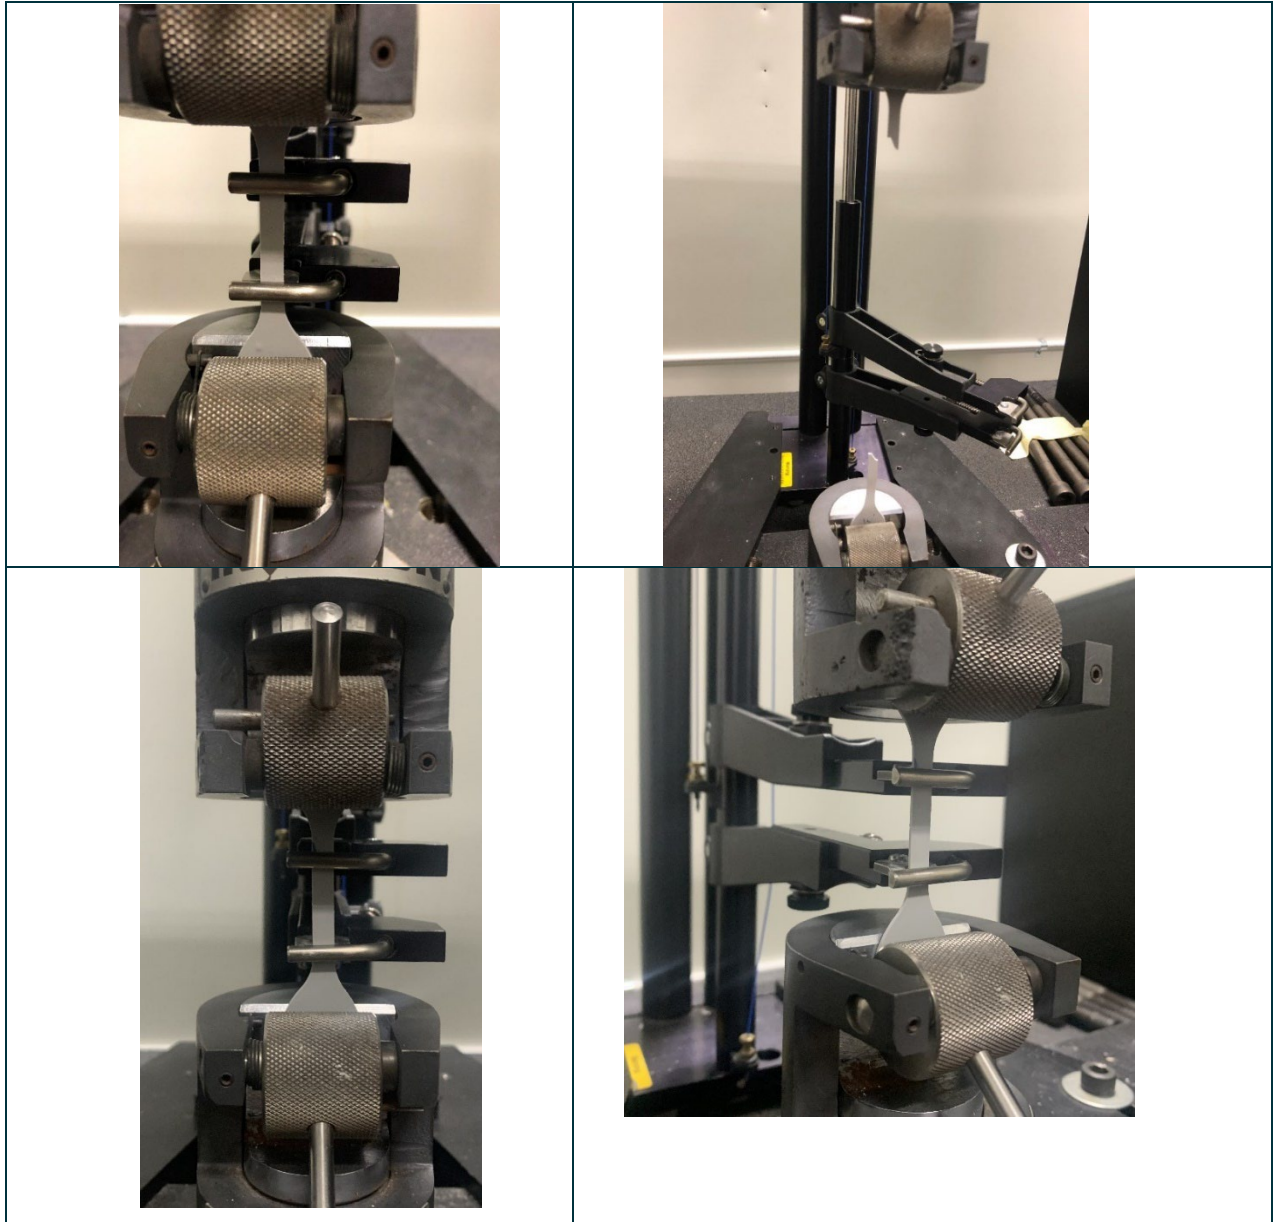


Figure 4 Images of test sample performing durability load / elongation test.



The performance criteria set out in AS/NZS 4858 – 2004, Table 8.1 (d), specifies a comparison of the immersed test samples to the unconditioned (control) test samples shall be greater than 50% elongation at break.

6 Comments

The Nitoproof 910 - Waterproofing Membrane, as described herein, when subjected to the test methods of AS/NZS 4858:2004 '*Wet area membranes*', the properties of (a) moisture vapour transmission, (b) water absorption, (c) cyclic movement (Class III), and (d) durability, met the performance criteria to AS/NZS 4858:2004 Wet Area Membranes.

- The thickness range for the control specimens of the 1st revalidation report SW8501.01 is 0.91 – 0.96mm, which is less than the thickness range of the control specimens for the original report 8319.1, where was the range of 1.22 – 1.27mm.
- The average result of the 1st revalidation of the Control' specimens of the for SW8501-01, AS/NZS 4858:2004 for Control is **332%**, which is **greater** than 300%, Class III – High Extensibility.

Prepared on behalf of CSIRO by

| | Author | Reviewer |
|----------|-----------------------------------------------------------------------------------|------------------------------------------------------------------------------------|
| Name | Ahmed Menisi | Ms Money Arora |
| Position | Technical Officer- Materials Performance | Acting team leader- Materials Performance |
| Date | 27 February 2026 | 27 February 2026 |
| |  |  |

CSIRO Science Connect

Infrastructure Technologies

Materials Performance

Gate 5, 2 Normanby Road

CLAYTON, VIC

AUSTRALIA 3168

Ph.: +61 (0)3 9545 8774

Web: <https://www.csiro.au/>

Fax: +61 (0)3 9544 1128

End of report